
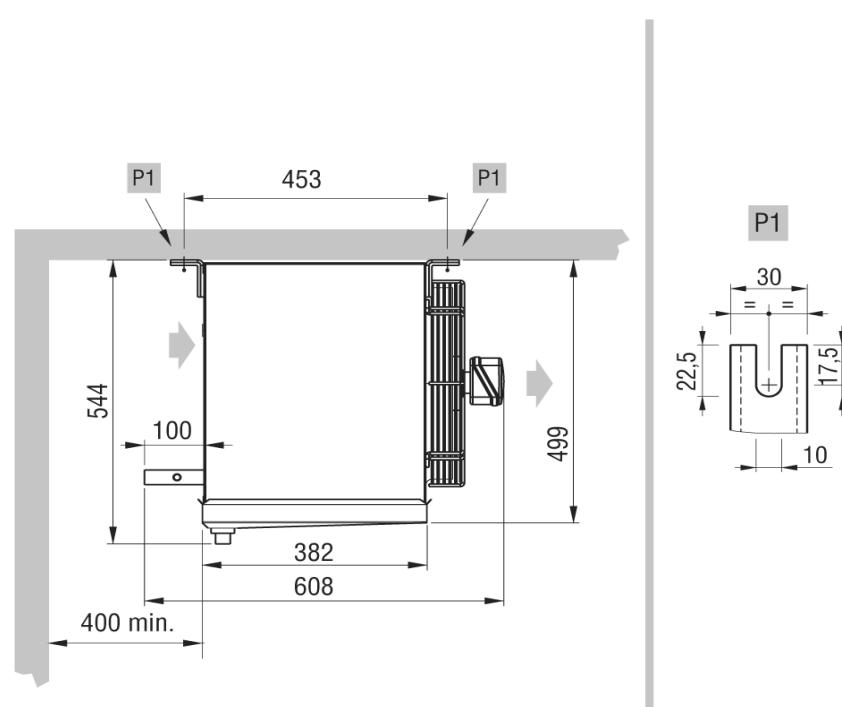


User : Annette Terney

Verification Unit cooler
31-03-2022

Inlet air temperature	[°C]	-20.0	Evaporating temperature	[°C]	-28.0
DT	[Δ°C]	8.0	Refrigerant *		CO2
Minimum number of units in room		0			
Heat exchanger	Aluminium fin			Casing	Standard
Fan motor feed	Standard		Type of fan motor	EC	
Defrost	ED				
Selected model: 1 x CGC 352A8				EC - ED	
Capacity	[kW]	7.84	Margin	[%]	0.0
DT	[Δ°C]	8.0	Tot. air flow	[m³/h]	5000.0

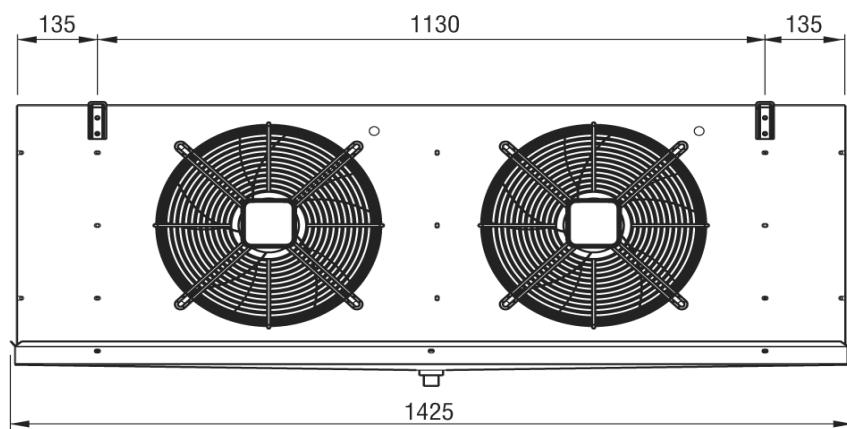

Weight	kg	51.000	[bar]		
Internal surface	m²	2.24	External surface	m²	25.00
Inlet connection		12.7 mm	Output connection		15.9 mm
Total circuit capacity	dm³	5.3	Fin spacing	mm	8
Drain connection		1" GAS			
Defrost	Electric			W	4050
Fan Motors	n.	2	Diameter	mm	350
Air flow	m³/h	5000	Air throw	m	15.0
Feed	V	230/1/50	Rotation speed	rpm	1450
Fan Motor	A	1.74	Absorbed power	W	300
Tot. Pres.S.Lev. 10 m.	dB(A)	48			



* The safety requirements for the use of refrigerants must comply with the provisions of the EN378 standards and the safety data sheets of each fluid used. The risk assessment for the use of A2L mid-flammable refrigerants shall be conducted by the user based on site requirements

EC fans: It is necessary to set these fans in order to get the required speed

User : Annette Terney

Verification Unit cooler
31-03-2022

EC - ED

Heat exchanger

Aluminium fin

Casing

Standard

Fan motor feed

Standard

Type of fan motor

EC - Electronically Commutated Motor

Defrost

ED - Electric



* The safety requirements for the use of refrigerants must comply with the provisions of the EN378 standards and the safety data sheets of each fluid used. The risk assessment for the use of A2L mid-flammable refrigerants shall be conducted by the user based on site requirements

EC fans: It is necessary to set these fans in order to get the required speed