

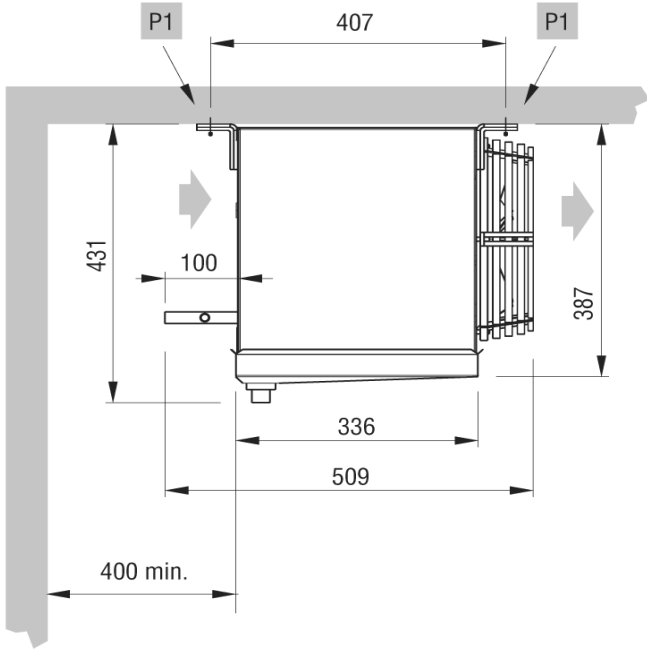


User : Annette Terney

Verification Unit cooler  
31-03-2022

Inlet air temperature	[ °C ]	-20.0	Evaporating temperature	[ °C ]	-28.0
DT	[ Δ°C ]	8.0	Refrigerant *		CO2
Minimum number of units in room		0			
Heat exchanger	Aluminium fin		Casing	Standard	
Fan motor feed	Standard		Type of fan motor	EC	
Defrost	ED				
Selected model: * 1 x CGC 251E6R			EC - ED		
Capacity	[ kW ]	0.98	Margin	[ % ]	0.0
DT	[ Δ°C ]	8.0	Tot. air flow	[ m³/h ]	753.0

\* Provide an appropriate defrosting system and number

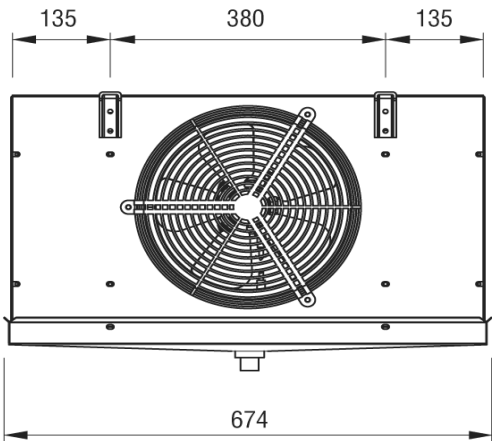

Weight	kg	13.000	[bar]		
Internal surface	m²	0.36	External surface	m²	5.17
Inlet connection		12.7 mm	Output connection		12.7 mm
Total circuit capacity	dm³	0.9	Fin spacing	mm	6
Drain connection		1" GAS			
Defrost		Electric	W		750
Fan Motors	n.	1	Diameter	mm	250
Air flow	m³/h	753	Air throw	m	9.0
Feed	V	230/1/50	Rotation speed	rpm	1300
Fan Motor	A	0.22	Absorbed power	W	26.0
Tot. Pres.S.Lev. 10 m.	dB(A)	31			

\* The safety requirements for the use of refrigerants must comply with the provisions of the EN378 standards and the safety data sheets of each fluid used. The risk assessment for the use of A2L mid-flammable refrigerants shall be conducted by the user based on site requirements

EC fans: It is necessary to set these fans in order to get the required speed

EC - ED

Heat exchanger

Aluminium fin

Casing

Standard

Fan motor feed

Standard

Type of fan motor

EC - Electronically Commutated Motor

Defrost

ED - Electric



\* The safety requirements for the use of refrigerants must comply with the provisions of the EN378 standards and the safety data sheets of each fluid used. The risk assessment for the use of A2L mid-flammable refrigerants shall be conducted by the user based on site requirements

EC fans: It is necessary to set these fans in order to get the required speed