




Instructions

EN INSTRUCTIONS

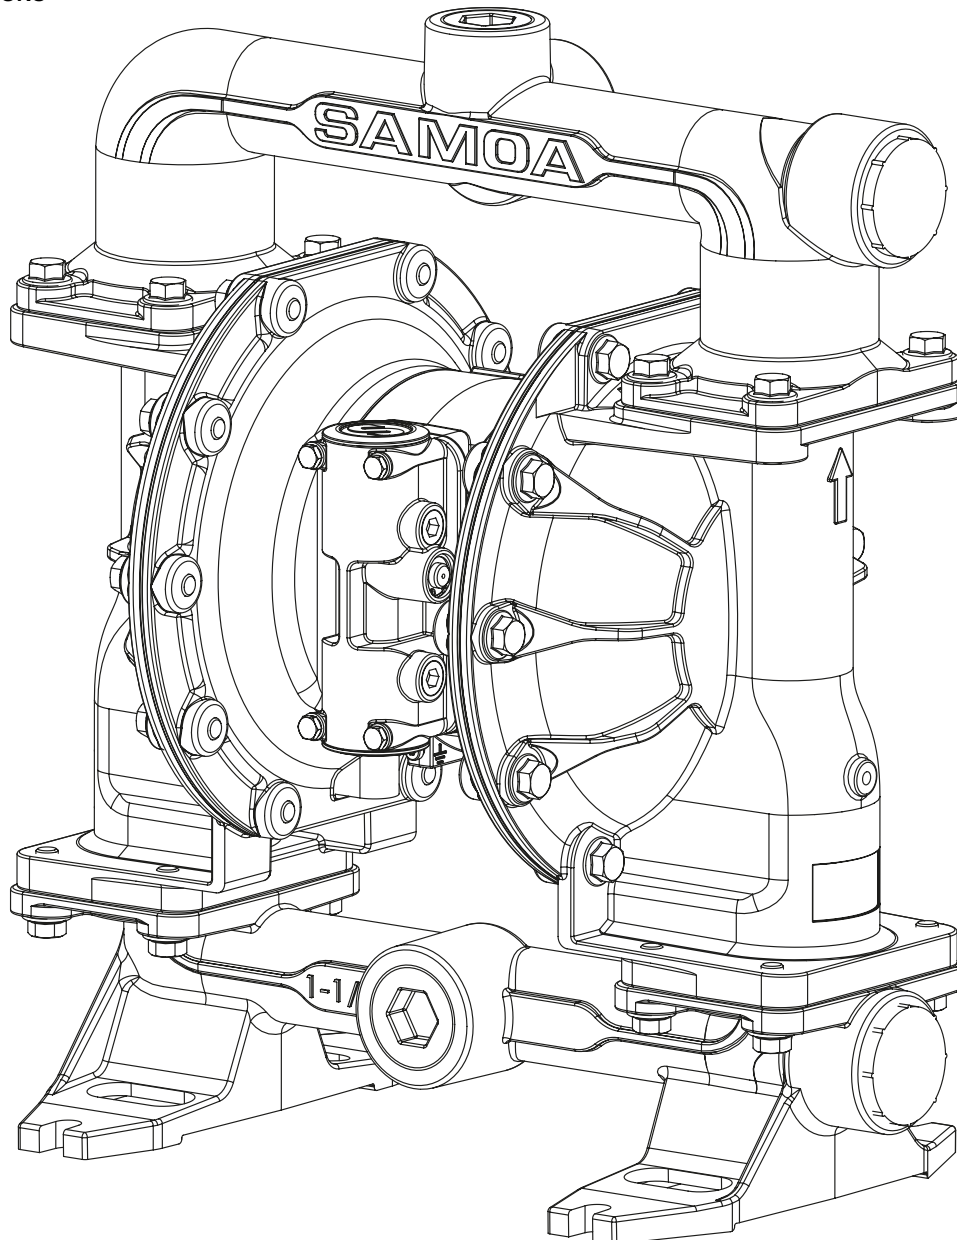

CE

Ex

EAC

PIVOT
UNIVERSAL PUMP

UP15 PIVOT SERIES, 1 1/2" METALLIC PUMPS

1. WARNINGS	4
2. TECHNICAL DATA	6
3. PUMP NOMENCLATURE	6
4. DIMENSIONS	7
5. PERFORMANCE GRAPHICS	7
6. DESCRIPTION	8
a. Installation Recommendations	8
b. Remote Exhaust Installation (optional)	9
c. Air Connection	9
7. OPERATION	10
a. Stopping the Pump for Maintenance Tasks	10
b. Grounding the Pump	10
c. ATEX Certified Pumps	10
8. TROUBLESHOOTING	11
9. MAINTENANCE	12
a. Torque Specifications	12
b. Air Motor	12
c. Air Exhaust	13
d. Air Sensors	14
e. Shaft, Bushing and Seals	15
f. Balls and Seats	16
g. Diaphragms	17
10. CE CERTIFICATE	19
11. KITS	

 Product pictures and specifications are subject to change without prior notice.
 The English version is a translation of the original document in Spanish. In case of a discrepancy, the original will prevail.

EQUIPMENT MISUSE HAZARD



- This equipment is for professional use only.
- Do not tamper the equipment.
- Use the equipment only for its intended purpose.
- Use only original replacement parts from Samoa Industrial, S.A.
- Install and use the pump following all local and national regulations including all health and safety laws and regulations.
- Avoid unnecessary damage to the pump. Do not allow the pump to run for long periods of time without fluid (dry). Disconnect the pump from the air line when the system is idle for long periods of time.

CHEMICAL COMPATIBILITIES AND TEMPERATURE LIMITS



- Chemical compatibility can change with temperature and concentration of chemicals within the fluids being pumped, discharged or circulated. For specific fluid compatibility, consult the chemical manufacturer.



- Maximum temperature limits are based upon mechanical stress only. Certain chemicals will significantly reduce maximum safe operating temperatures. Consult the chemical manufacturer for temperature limits.



- Fluids that are not compatible with the pump materials can cause damage to the pump and may cause serious personal injuries. Always consult your authorized Samoa supplier if you have questions regarding the pump and fluid compatibility.

- Do not exceed material temperature limits:

MATERIAL	TEMPERATURE RANGE
PTFE	-10 °C / +107 °C / -14 °F / +225 °F
NBR	-23 °C / +82 °C / -10 °F / +180 °F
Acetal	-40 °C / +120 °C / -40 °F / +250 °F
Hytrel®	-29 °C / +104 °C / -20 °F / +220 °F
Neoprene	-18 °C / +93 °C / 0 °F - 200 °F
Santoprene®	-40 °C / +135 °C / -40 °F / +275 °F
Viton®	-40 °C / +177 °C / -40 °F / +350 °F
Polypropylene	0 °C / +65 °C / +32 °F / +150 °F
PVDF (Kynar®)	-40 °C / +121 °C / -40 °F / +250 °F



SAFETY MEASURES



- Ensure that operators using this equipment are trained on the operation, the product and its limitations.



- Use safety equipment as required.



- Do not use a model with aluminium wetted parts to pump fluids for human consumption, there is a possibility of trace contamination of lead.



- Do not exceed the maximum air pressure. Make sure that hoses and other components are rated for the pump's maximum working pressure. Check all hoses for damage or wear.



- Never use a pump that leaks, that is damaged, that is corroded or otherwise it may lack the capacity to contain the fluid.

- Frequently check that the bolts on the pump fluid covers are correctly torqued.

- Check the diaphragm conditions. If a diaphragm is broken, the fluid can leak out of the air exhaust and cause personnel injuries or contaminate the environment.

- When handling hazardous fluids, always route the air exhaust into a suitable container and locate it in a safe place. Install a suitable container surrounding the pump to prevent any leaks or spills.

FIRE AND EXPLOSION HAZARD



- Prevent static sparking. If static sparking occurs, fire or explosion could result. Pump, valves, and containers must be properly grounded when handling flammable fluids and whenever discharge of static electricity is a hazard.



- Danger of explosion if 1,1,1-trichloroethane, methylene chloride or other halogenated hydrocarbon solvents are used with wetted parts made from aluminium. It could cause serious injury and property damage. Check the motor section of the pump, fluid covers, manifolds and all wetted parts in order to ensure compatibility before using these solvents.

- In order to avoid hazardous conditions that can cause fire or explosion all label and marking material must be cleaned to enable proper reading.

The 1 1/2" (38 mm) air operated diaphragm pumps, made of cast metal, feature the innovative SAMOA Air Distribution System for superior performance and efficiency. They can achieve a flow rate of up to 475 l/min (125 gal/min), offering high-capacity fluid transfer. Additionally, it incorporates the new Quick-fill valve, which ensures precise air chamber filling and reduces consumption. In the aluminium and ductile iron versions, external and internal e-coated manifolds, fluid chambers, air chambers, and the central body provide enhanced corrosion resistance and durability. For maximum installation versatility, the manifolds can rotate 180°, allowing flexible positioning to suit various applications.



Aluminium version

Non contractual pictures.

1 1/2"
475 l/min
(125 US gal/min)

MAIN APPLICATIONS

- OIL & GAS/PETROCHEMICAL
- MINING & CONSTRUCTION
- PULP & PAPER
- CHEMICAL PLANT PROCESSING
- PAINTS & COATINGS
- TEXTILES, LEATHERS & GARMENTS
- PLANT AND MECHANICAL ENGINEERING
- WASTEWATER & WATER TREATMENT
- MARINE
- CERAMICS
- ENERGY
- ELECTRONICS

TECHNICAL DATA

UP15 METALLIC PUMPS

Pressure Ratio	1:1										
Maximum Free Delivery	475 l/min (125 US gal/min)										
Air pressure range	1,5 to 8 bar (20 to 120 psi)										
Solids in suspension, Max. size	6,4 mm (1/4")										
Max dry suction lift	6 m (19.6')										
Max wet suction lift	9 m (29.5')										
Displacement per cycle*	2,5 l (0.66 gal)										
Fluid inlet/outlet ports	1 1/2" NPT (F) Threaded 1 1/2" BSP (F) Threaded 1 1/2" ANSI/DIN Flanged										
Air Inlet Port	1/2" NPT (F)										
Air Exhaust Port	1" NPT (F)										
Sound level	75 dB (A) @50 cycles/min @5 bar (70 psi)										
Material and weight: Central Body/ Fluid Chamber & Manifolds	<table> <tr> <td>Threaded</td><td>Flanged</td></tr> <tr> <td>Aluminium / Aluminium</td><td>22 kg (48.5 lb)</td></tr> <tr> <td>Aluminium / Ductile Iron</td><td>36 kg (79.4 lb)</td></tr> <tr> <td>Aluminium / 316 SS</td><td>38 kg (83.8 lb)</td></tr> <tr> <td></td><td>41,5 kg (91.5 lb)</td></tr> </table>	Threaded	Flanged	Aluminium / Aluminium	22 kg (48.5 lb)	Aluminium / Ductile Iron	36 kg (79.4 lb)	Aluminium / 316 SS	38 kg (83.8 lb)		41,5 kg (91.5 lb)
Threaded	Flanged										
Aluminium / Aluminium	22 kg (48.5 lb)										
Aluminium / Ductile Iron	36 kg (79.4 lb)										
Aluminium / 316 SS	38 kg (83.8 lb)										
	41,5 kg (91.5 lb)										

* Delivery per cycle depends on the diaphragm materials, air inlet pressure and fluid viscosity.


3. PUMP NOMENCLATURE

Examples: **UP15A-XXX-XXX**
UE15A-XXX-XXX-X


UP15X		XXX			XXX			X
PUMP TYPE	AIR MOTOR	HOUSINGS			WETTED PARTS			ACCESSORIES
1 Pump Type & Size	2 Central Body & Air Chambers	3 Fluid Ports / Location Multiport manifolds: central, vertical and lateral	4 Fluid Chambers & Manifolds	5 Hardware Bolts	6 Valve Seats	7 Valve Balls	8 Diaphragms Type & Material	9 Accessories (UE pumps only)
UP15 Universal Pump (Bolted) UE15 Universal Pump (Bolted) with electronic interface	ATEX Certified A = Aluminium S = AISI 316 Stainless Steel (only for pumps with Stainless Steel Fluid Chambers & Manifolds)	B = 1 1/2" BSP threaded ports/ Lateral & Central (only in Aluminium versions) C = 1-1/2" ANSI / DIN flanged ports / Central horizontal (only in Stainless Steel) N = 1 1/2" NPT threaded ports/ Lateral & Central (only in Aluminium versions) V = 1 1/2" ANSI / DIN flanged ports/Central horizontal inlet, Central vertical outlet (only in Stainless Steel)	ATEX Certified A = Aluminium F = Ductile Iron S = AISI 316 Stainless Steel	C = Carbon Steel S = Stainless Steel	A = Aluminium D = AISI 440 Hardened Stainless Steel H = TPE (Hytre®) M = TPV (Santoprene®) N = Nitrile (Buna-N) T = PTFE (Teflon®) S = AISI 316 Stainless Steel V = FKM (Viton®)	H = TPE (Hytre®) M = TPV (Santoprene®) N = Nitrile (Buna-N) T = PTFE (Teflon®) S = AISI 316 Stainless Steel V = FKM (Viton®)	Conventional A = TPV (Santoprene®) C = TPE (Hytre®) G = Nitrile (Buna-N) V = FKM (Viton®) Two piece Z = PTFE (Teflon®) with TPV (Santoprene®) backer	A = Diaphragm leak detectors B = Diaphragm leak detectors (ATEX) C = Stroke sensor D = Stroke sensor (PLC) E = Stroke sensor (ATEX) F = Diaphragm leak detectors + Stroke sensor G = Diaphragm leak detectors + Stroke sensor (PLC) H = Diaphragm leak detectors + Stroke sensor (ATEX)

Viton® & Teflon® is a registered trademark of the Chemours Company, Santoprene® and Hytre® is a registered trademark of the Celanese Corporation, L.P. Kynar® is a registered trademark of Arkema, Inc.


Stainless steel flanged pumps

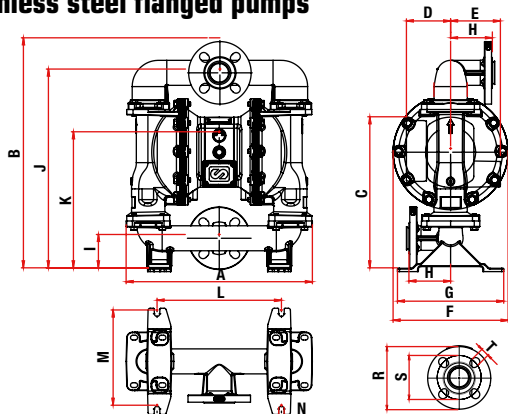


Aluminium threaded pumps

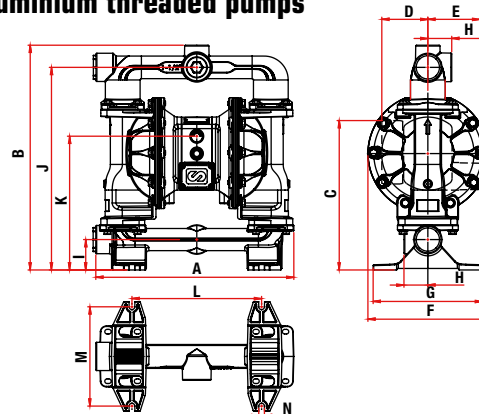

Stainless steel vertical flanged pumps

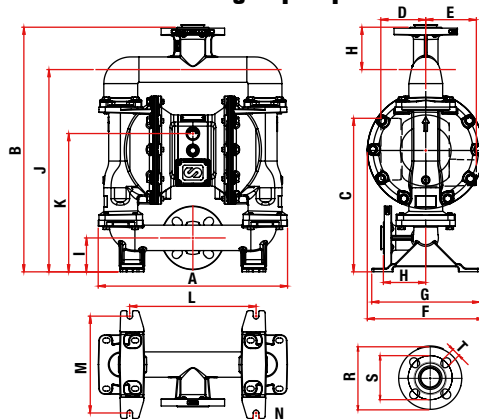

Stainless steel / Ductile Iron threaded pumps

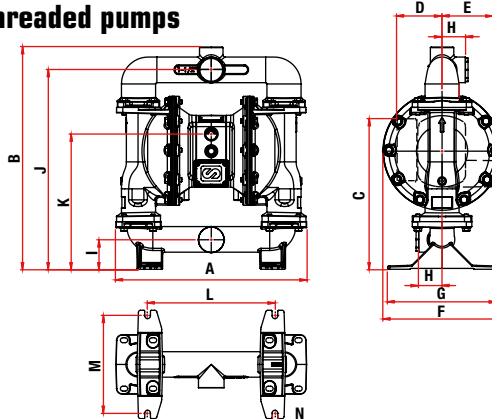

DIMENSIONS (mm)

UP15 FLANGED

UP15 THREADED

A	B	C	D	E	F	G	H	I	J	K	L	M	N	R	S	T
447	577,5	362,5	106	220	276	255	100	80	477	326,5	298,5	228,6	13	150	104,7	20
456	517,5	344	106	220	276	252	55	70	466,5	308	298,5	228,6	13	-	-	-



DIMENSIONS (inches)

UP15 FLANGED

UP15 THREADED

A	B	C	D	E	F	G	H	I	J	K	L	M	N	R	S	T
17.6	22.7	14.13	4.2	8.7	10.9	10	3.9	3.2	18.8	18.86	11.8	9	0.59	5.9	4.1	0.78
17.95	20.4	13.5	4.2	8.7	10.9	9.9	2.2	2.8	18.4	12.1	11.8	9	0.59	-	-	-

5. PERFORMANCE GRAPHICS

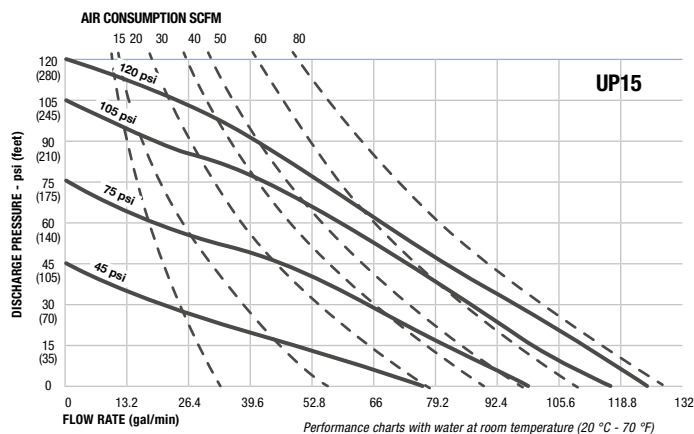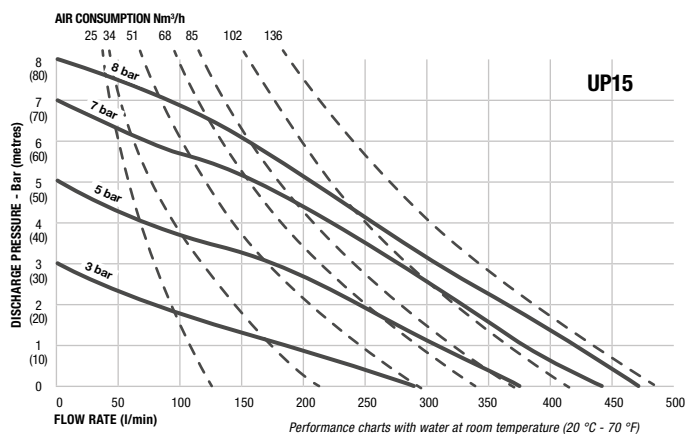


AVAILABLE VERSIONS

FLANGED PUMPS



Stainless Steel



Stainless Steel

THREADED PUMPS



Aluminium



Stainless Steel




Ductile Iron

- Air operated double diaphragm pumps are air-powered, reciprocating positive displacement pumps.
- They have two opposite pump volumes and a diaphragm divides each volume into an air and a liquid chamber.
- The diaphragms are connected with a shaft.
- During one pumping stroke, the fluid is suctioned into one of the liquid chambers while simultaneously the other one is discharged.

a. Installation Recommendations

- Install the pump as close as possible to the fluid being pumped to minimise the suction head.
- For the ease of operation and service, install the pump so there is enough space around it.
- If the pump is installed in a place where fluid leakage can cause an environmental impact, the exhaust should be directed to a place where it can be contained.
- When installing the pump, use the mounting feet and appropriate hardware to secure it.
- Before installing, tighten all bolts to the specified torque values listed in the Maintenance section of the manual. Run the pump for 24 hours, then check the bolt torques again.
- Pumps can be installed with flooded suction, suction lift or submerged in the fluid pumped.
- The figure below shows the recommended configuration for the pump installation.

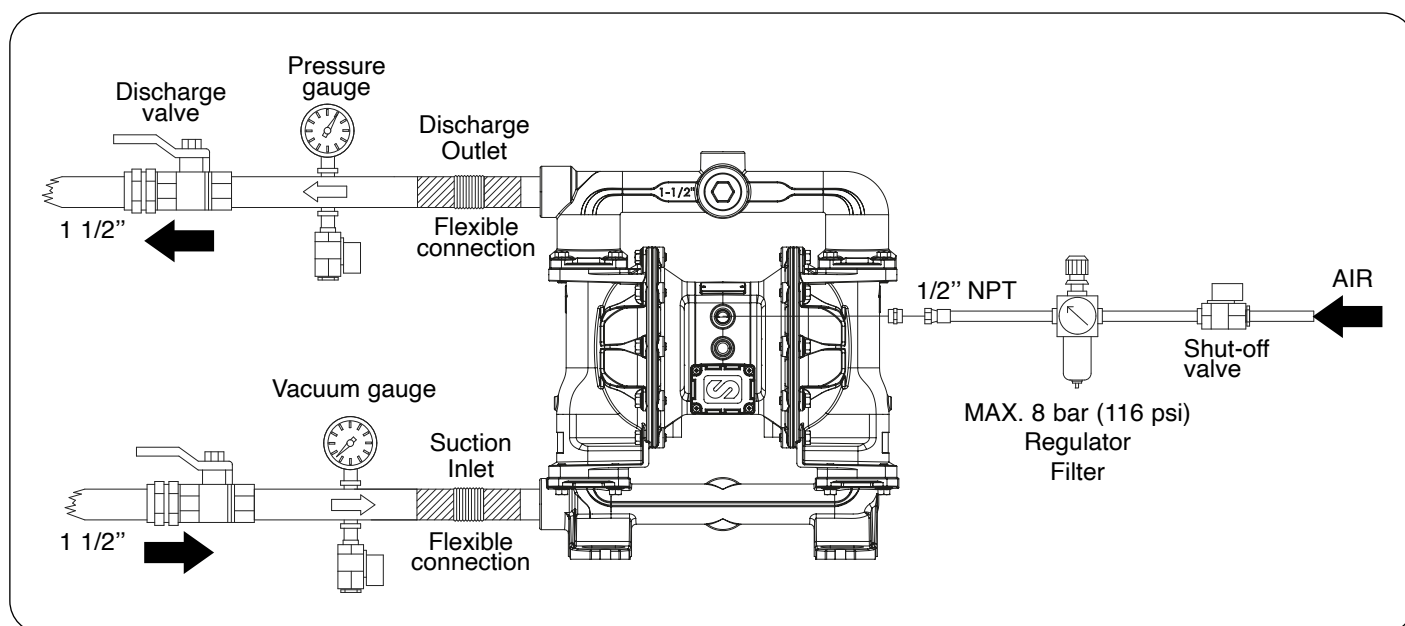

2025_09_15-17:25


b. Remote Exhaust Installation (optional)



WARNING

The pump exhaust should be directed to a safe location to avoid damage to personnel and installations.

- Remove the pump air muffler.
- Connect a hose with a 1/2" NPT thread to the new exhaust port and install the muffler at the end of the hose.
- Be sure the air exhaust is directed to a safe place.

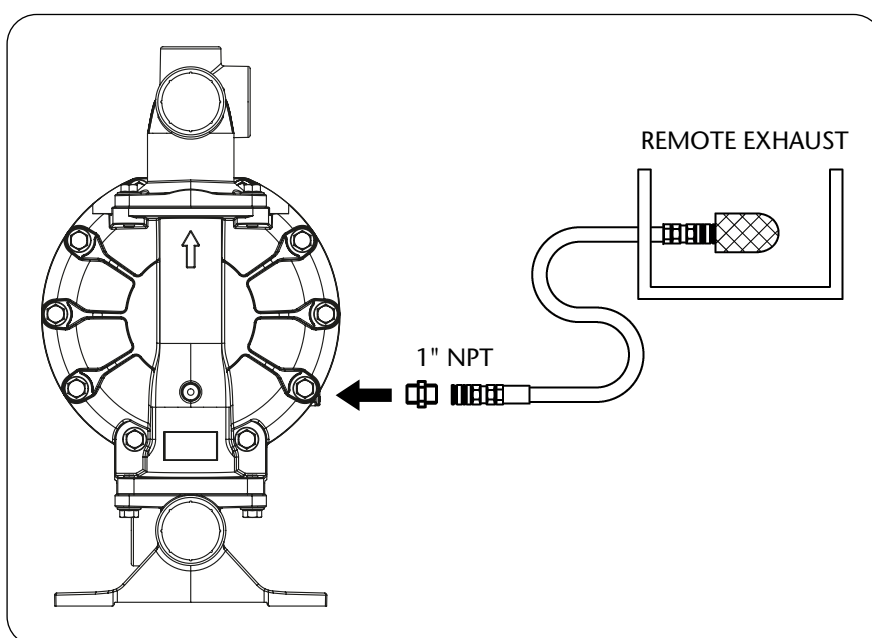

c. Air Connection



WARNING

- To ensure that the air flow is sufficient to meet the pump demand, the air pipe diameter must be equal to the pump air inlet.
- Air treatment equipment must be dimensioned to meet pump air demand. It must be installed as close as possible to the pump unit.
- Using air quick couplers to connect the air hoses facilitates pump maintenance.

2025_09_15-17:25

This pump is self-priming. To prime it for the first time connect the pump air inlet to a low air pressure supply. Keep the outlet valve open and gradually increase the pressure until the fluid comes out of the pump outlet.

For the performance characteristics of the pump see the performance chart (TECHNICAL DATA section).

a. Stopping the Pump for Maintenance Tasks

- Shut off the air supply to the pump.
- Close the discharge valve and the suction valve. Open inlet and outlet drain valves if installed.
- Open the air valve of the pump, start up the pump and flush the remaining fluid.
- Close the air valve.
- Maintenance can be started after ensuring that the pump is turned off and the pressure is released.
- Unground the pump.

b. Grounding the Pump




WARNING

If the pump operates ungrounded or with an incorrect connection, friction between parts and fluid abrasion can generate static electricity. Depending on the fluid pumped and the installation environment, static electricity can cause either fire or electric shock.

When installing the pump, be sure to perform grounding in the specified location if required.

Also connect ground wires for the auxiliary equipment and piping.

Use a grounding cable of at least 12 AWG (2.0 mm).

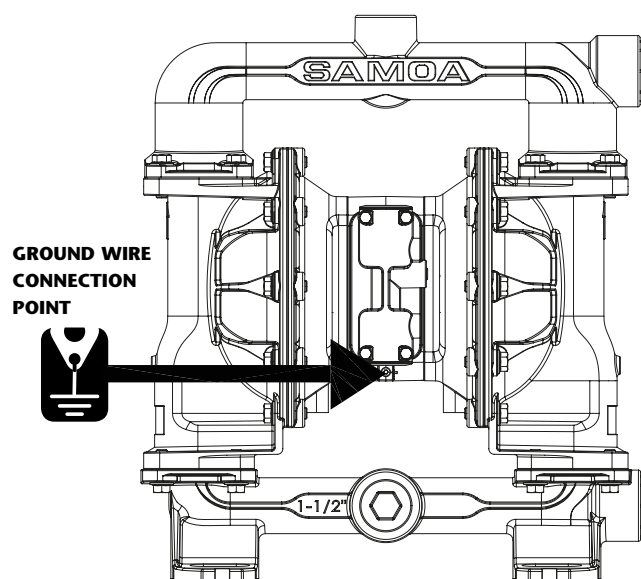

c. ATEX Certified Pumps

If your pump is ATEX certified, a specific Atex manual is included. Read this manual before operating the pump.

If the symbol "Ex" is in the pump nameplate it can be used in the potentially explosive atmospheres indicated areas (details on the ATEX manual).



CAUSE	RECOMMENDED MEASURE
The pump does not work	
Discharge valve on the discharge side is not open.	Open the valve on the discharge side.
No air supply.	Turn on the compressor and open the air valve and air regulator.
Low air supply pressure.	Check the compressor and the air line configuration.
Air leaks in connecting components.	Tighten air connections or replace components.
Air pipes or additional equipment is clogged.	Check and clean the air line.
Pump exhaust port (muffler) is clogged.	Check and clean the exhaust port and muffler.
Fluid pipe is clogged.	Check and clean the fluid line.
Clogged pump.	Remove, inspect and clean the pump.
The pump runs but no fluid comes out	
Valve on the suction side is not open.	Open the valve on the suction side.
Too much suction or discharge height.	Reduce lengths/heights of suction and discharge pipes.
Fluid pipe on the discharge side (including the filter) is clogged.	Check and clean the fluid line.
Clogged pump.	Dismantle the pump, check and clean.
Balls and/or ball seats are worn or damaged.	Inspect and replace parts.
Decreasing flow	
Low air supply.	Check the compressor and the air line configuration.
Air line or peripheral equipment is clogged.	Check and clean the air line.
Valve on the discharge side will not open normally.	Adjust the discharge valve on the discharge side.
Air mixes with the fluid.	Replenish with fluid and check the pipe configuration on the suction side.
Pump is vibrating.	Adjust air supply pressure and discharge pressure. Reduce the inlet valve flow to adjust the pressure and fluid volume. Securely fasten the pump to the base using the mounting feet and appropriate hardware.
Ice formation in the air exhaust.	Remove ice from the air bypass valve and check and clean the air filter. Use a pipe in the air exhaust so there is no ice formation in the muffler.
Fluid line (including the filter) is clogged.	Check and clean the fluid pipe and strainer.
Pump exhaust port (muffler) is clogged.	Check and clean the exhaust port and muffler.
Clogged pump.	Remove, inspect and clean the pump body.
Discharge fluid contains air bubbles	
Damaged diaphragm.	Replace diaphragm.
Loose or broken suction hose.	Tighten or replace.

a. Torque Specifications



CAUTION

Do NOT overtighten fasteners. Shut off the air supply before any intervention. Be aware of a possible fluid leakage inside the pump.


For proper pump operation and to prevent accidents, you must periodically review the torques of the diaphragms covers and the directional valve. The table shows the appropriate torques for this purpose:

	UP15A-XAX-XXX Aluminium
Fluid Chamber	50 N·m (36.88 ft·lbs)
Manifolds	50 N·m (36.88 ft·lbs)
Air Motor	6 N·m (4.42 ft·lbs)
Fluid Piston	50 N·m (36.88 ft·lbs)
Air Chamber - Central Body	20 N·m (14.75 ft·lbs)
Air Sensors	1,5 N·m (1.11 ft·lbs)



CAUTION

TIGHTENING SEQUENCE

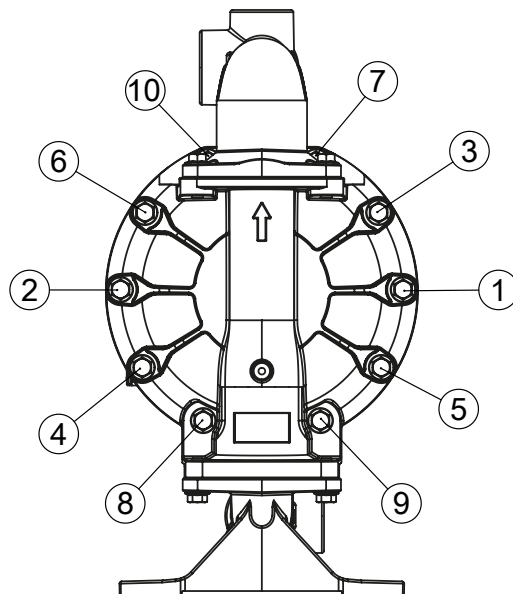

b. Air Motor





NOTE

Before conducting any maintenance on the pump, follow the instructions in the "Stopping the Pump for Maintenance Tasks" section of the Service Guide.

1. Remove the 4 fastening screws of the air motor to the central body (A).
2. Position and assemble the new air motor (B) on the central body. Tighten and torque the screws (A).

NOTE: The air motor has a poka-yoke to ensure the correct positioning and assembly of the air motor to the central body.

6 N·m
(4.42 ft·lbs)

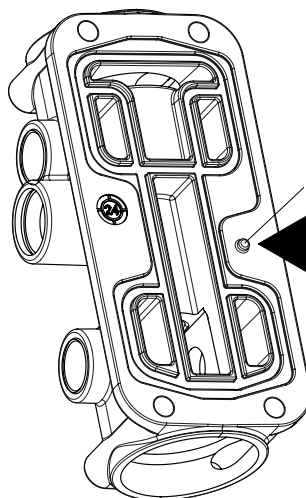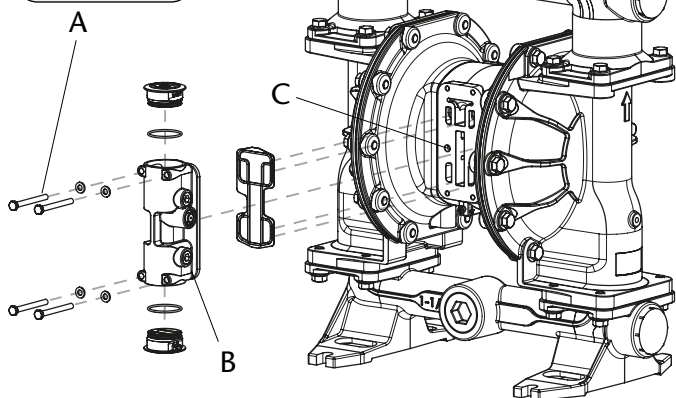

Poka-Yoke
Positioning

c. Air Exhaust



NOTE

Before conducting any maintenance on the pump, follow the instructions in the "Stopping the Pump for Maintenance Tasks" section of the Service Guide.


1. Remove the 4 screws (A) securing the porous air exhaust (B).

2. Position and assemble the new porous exhaust (B) on the central body. Screw in the 4 fixing screws of the porous exhaust.

NOTE: The central body of the pump allows the assembly of a nose muffler (C) as detailed in the figure. In this case, simply unscrew the porous muffler and assemble the new nose muffler to the 1" NPT air exhaust port.

Possibility of mounting 2 types of muffler:

- Nose Muffler
- Porous Muffler

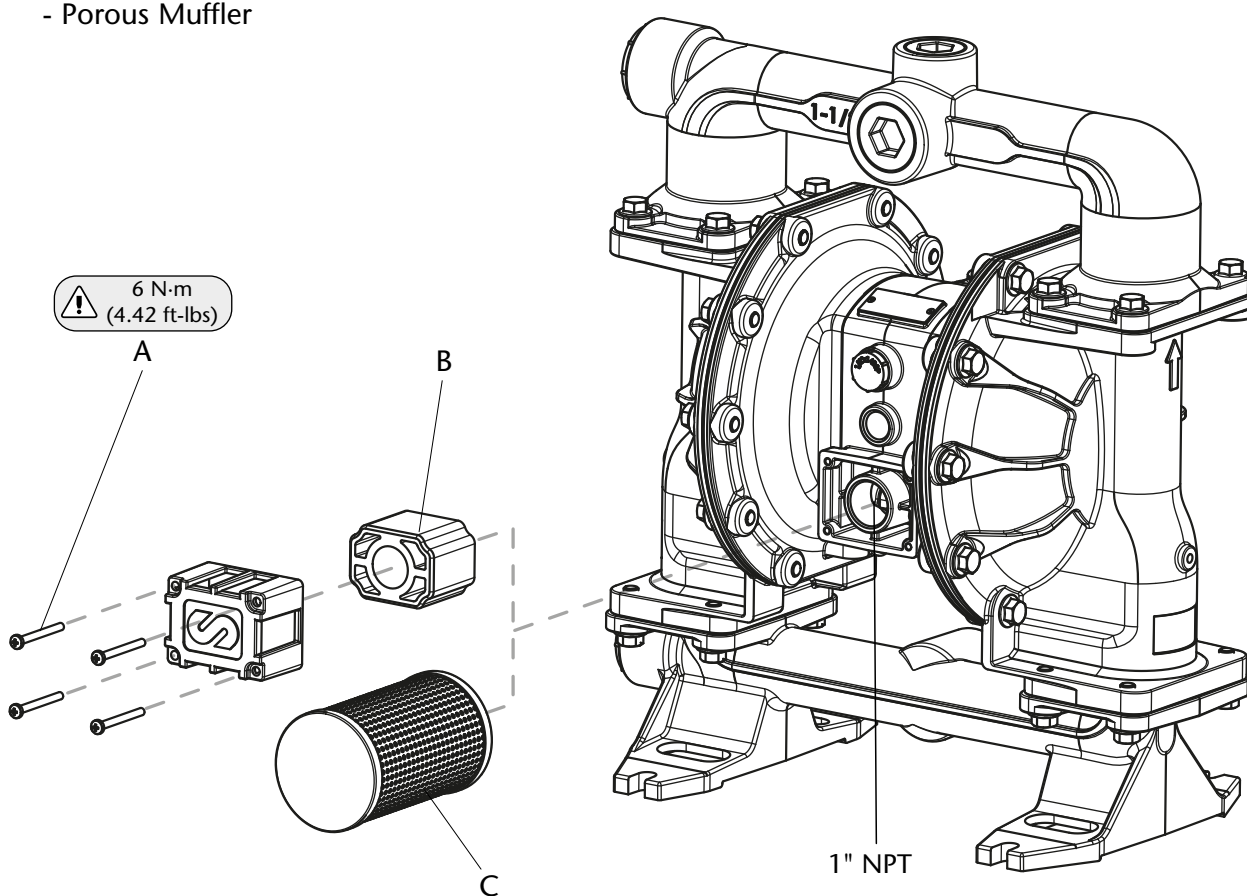


d. Air Sensors



NOTE

Before conducting any maintenance on the pump, follow the instructions in the "Stopping the Pump for Maintenance Tasks" section of the Service Guide.

1. Unscrew the screws (A) and remove the upper (B) and lower (C) manifolds.
2. Remove the fluid chambers (D).
3. Remove the screws securing the sensor cover (E). Remove all components and clean the area.
4. Incorporate the new components in the order shown in the figure (F).
5. Replace the sensor cover and tighten the screws (G).

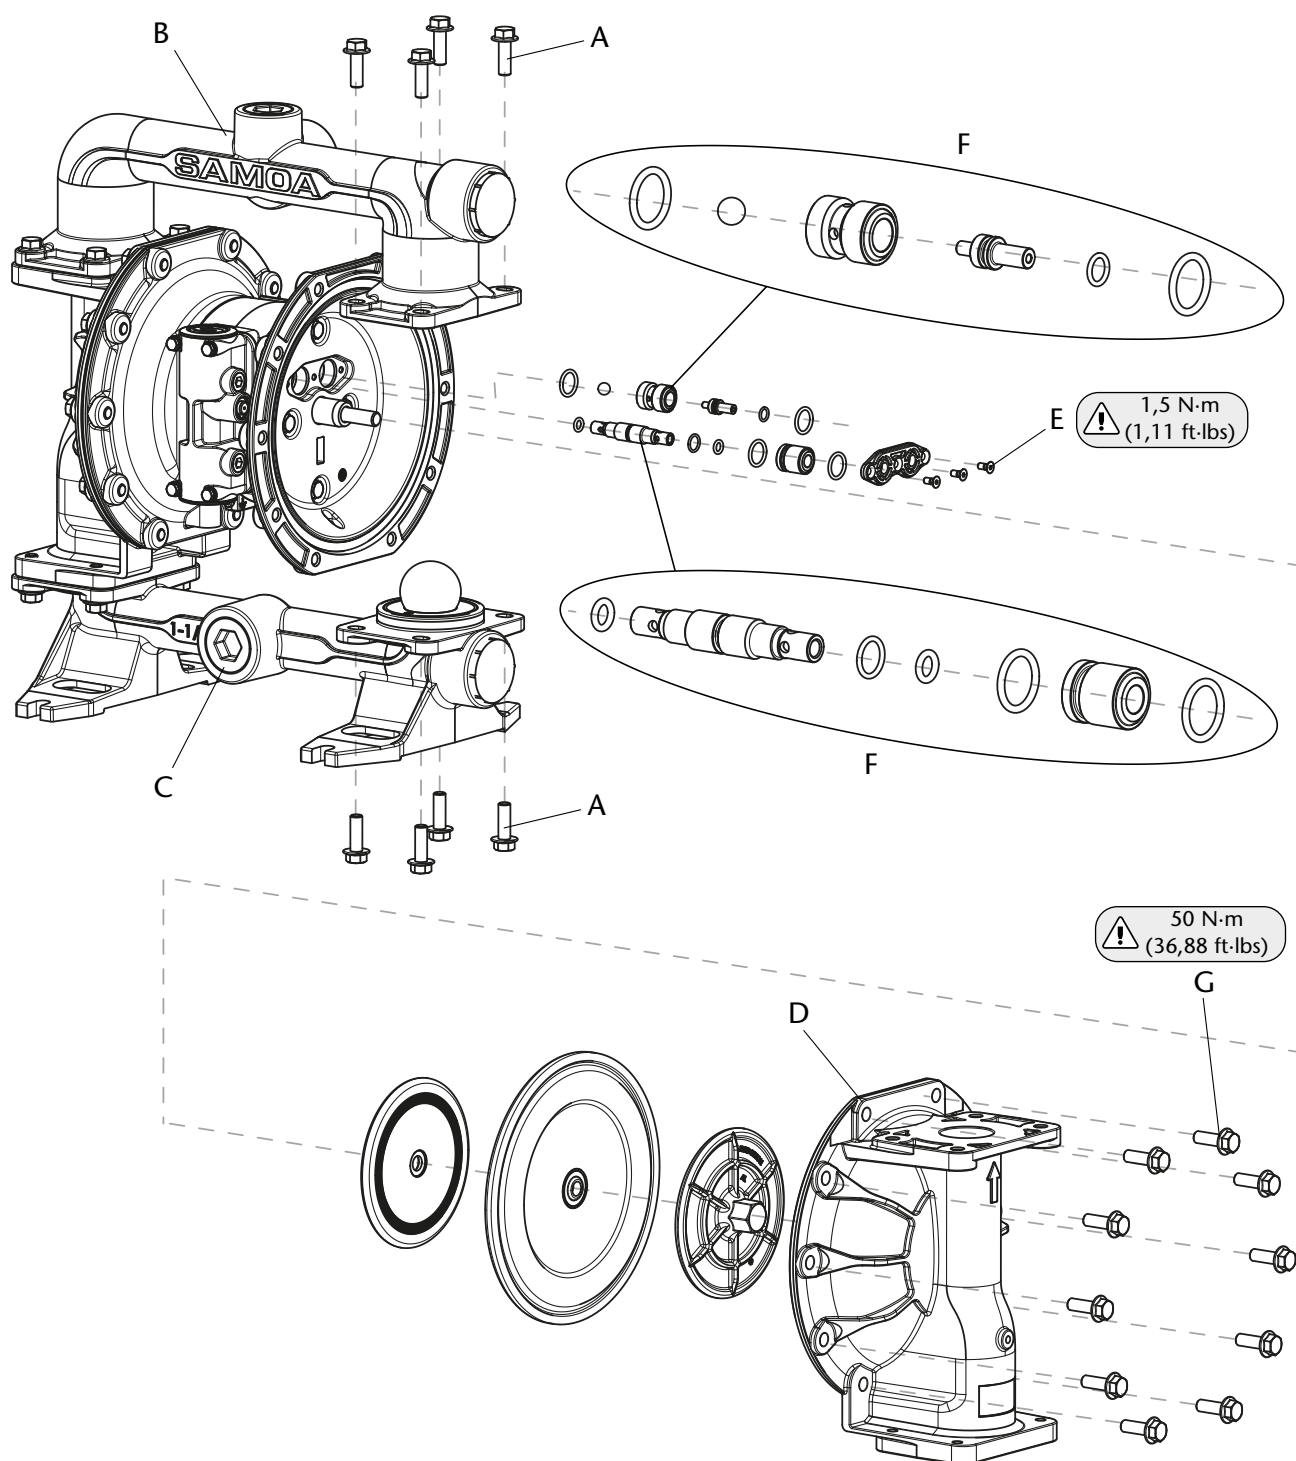


e. Shaft, Bushing and Seals



NOTE

Before conducting any maintenance on the pump, follow the instructions in the "Stopping the Pump for Maintenance Tasks" section of the Service Guide.

1. Unscrew and remove the upper and lower manifolds and remove the fluid chambers.
2. Replace the bushing (A) and the pneumatic seals (B).
3. Clean the area and apply grease to the shaft (C).
4. Replace all components in reverse order.
5. Replace the air chamber (D) and tighten the screws (E).

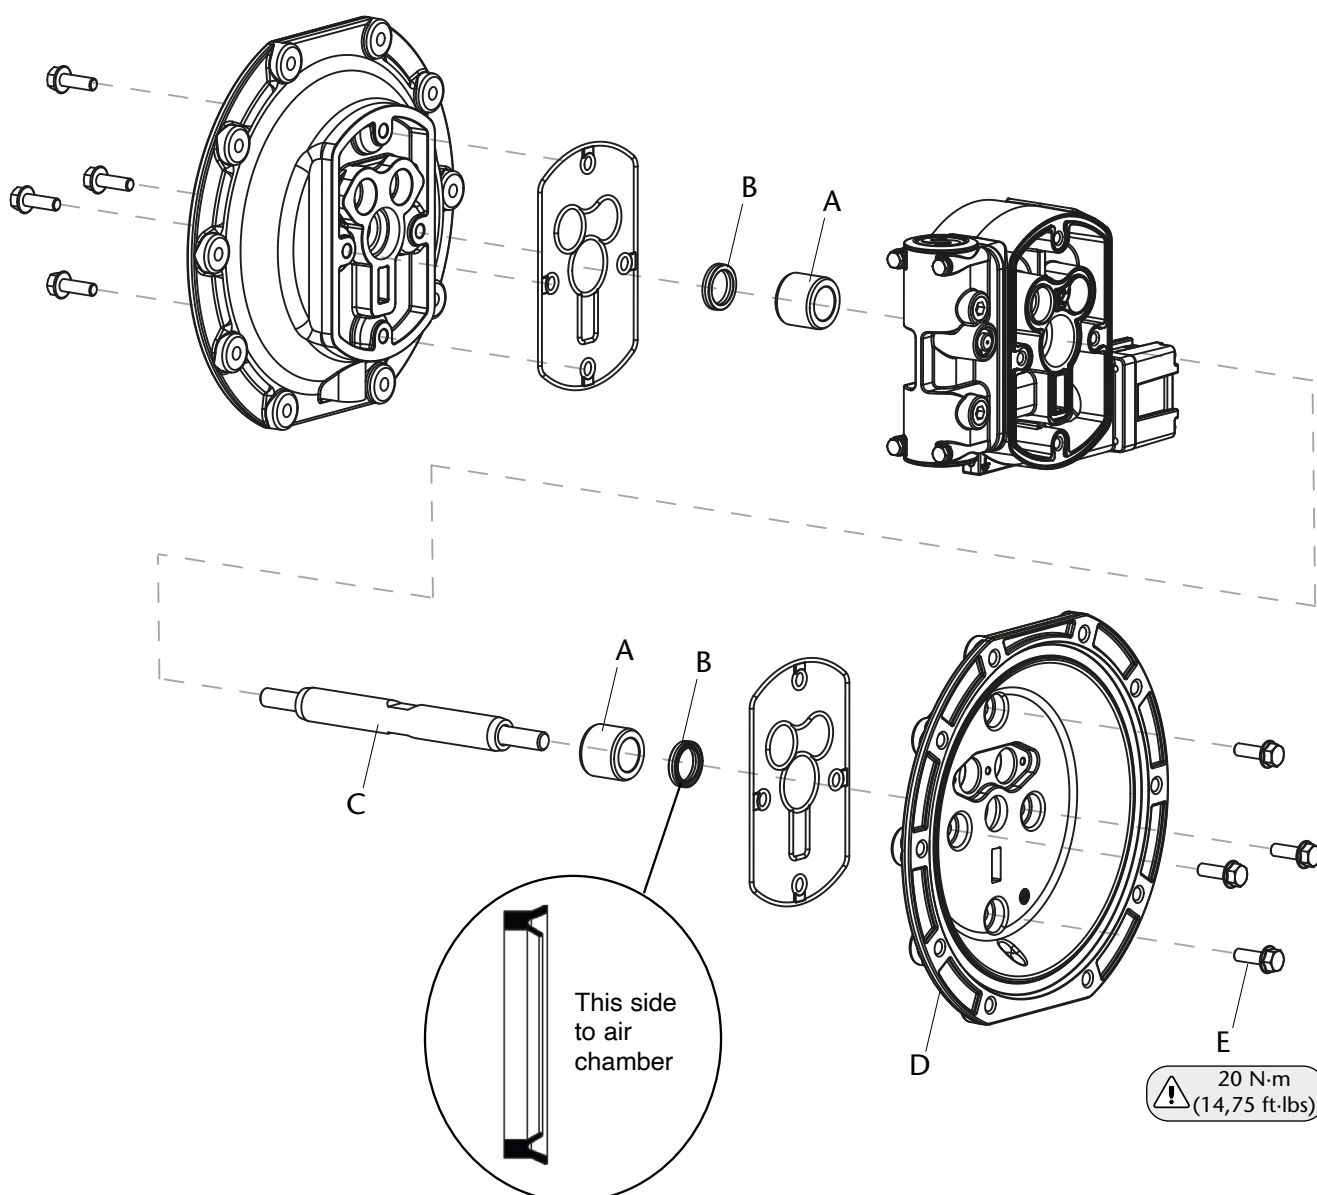

2025_09_15-17:25

f. Balls and Seats

! IMPORTANT


Progressively approach the manifold with the bolts before final tightening.
Soft seats (D) do not require gaskets and can be installed face up or face down.
Rigid seats (E) employ additional gaskets.
The balls (F) must always be placed above the seats.
If pump maintenance involves disassembly of the manifolds and the pump is configured with PTFE O-rings (white color), these must be replaced with new ones to prevent liquid leakage.

! NOTE

Before conducting any maintenance on the pump, follow the instructions in the "Stopping the Pump for Maintenance Tasks" section of the Service Guide.

1. Remove the inlet (A) and outlet (B) manifolds.

2. Install a new set of ball or seats according to these assembly drawings. Bring the manifolds together with the bolts (C) and tighten them crosswise to the recommended torque.

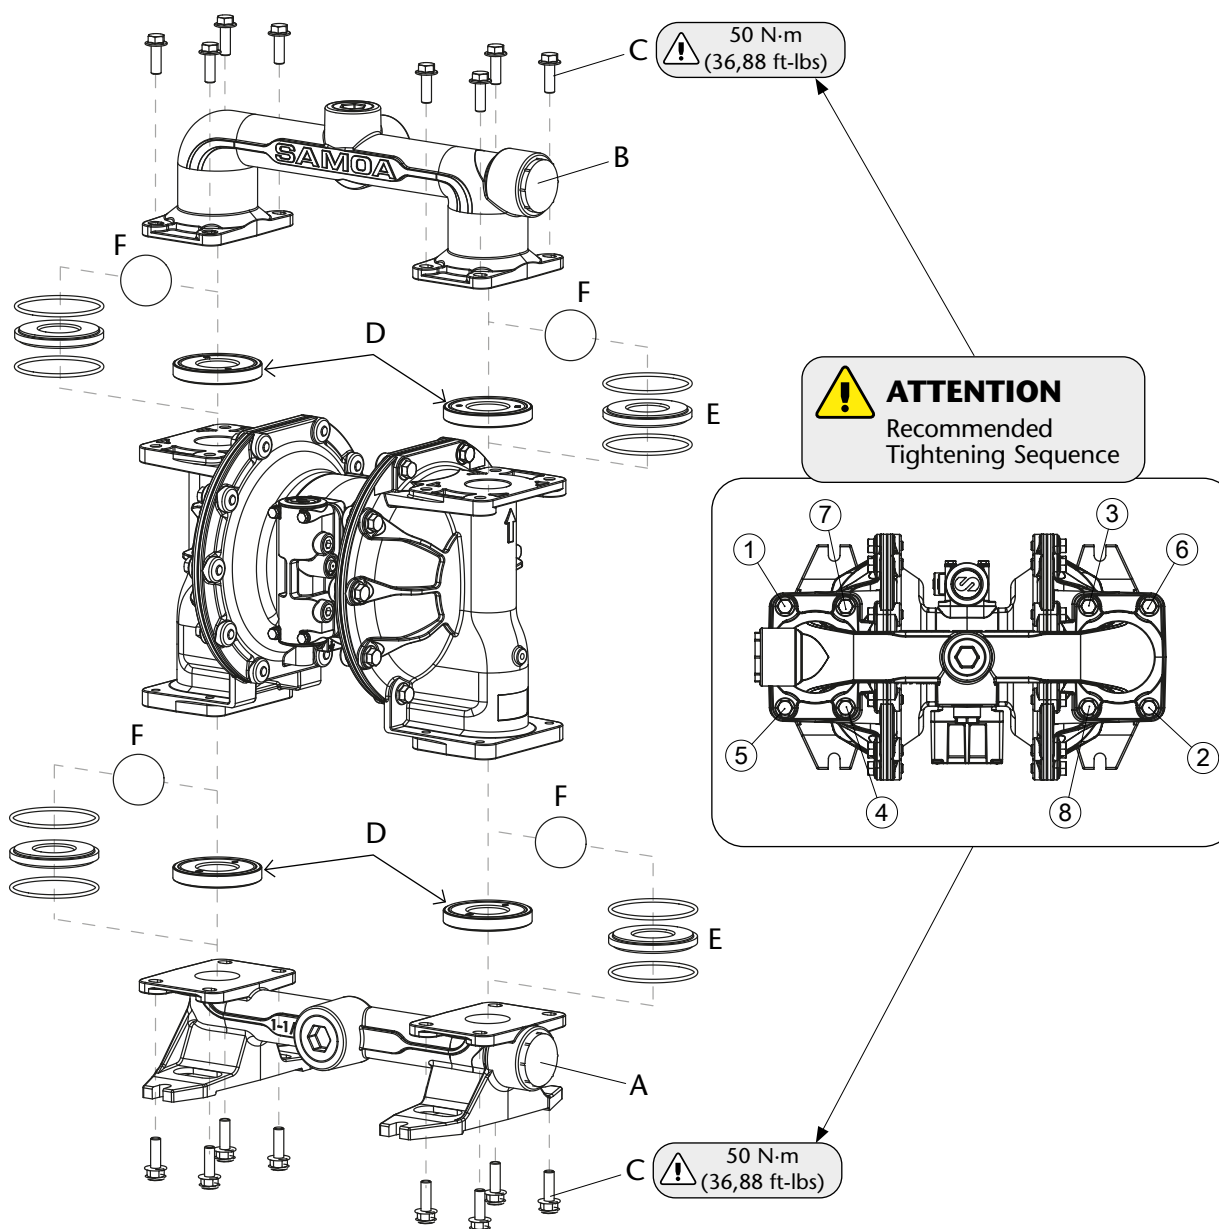


g. Diaphragms



NOTE

Before conducting any maintenance on the pump, follow the instructions in the "Stopping the Pump for Maintenance Tasks" section of the Service Guide.

1. Unscrew the outlet manifold (A) and lift it. Remove the valve seats, o-ring (if applicable) and balls.
2. Turn the pump upside down to remove the inlet manifold (B) screws. Remove the seats, seals (if necessary) and balls.
3. Unscrew the fluid cover (C) screws and remove it by gently pulling back.
4. Remove the used diaphragm.
 - a) Conventional diaphragms (D): use an adjustable wrench and apply the appropriate torque on the fluid piston (E).
 - b) Two-piece diaphragms (F): use an adjustable wrench and apply the appropriate torque on the fluid piston (E).
5. Repeat for opposite side.

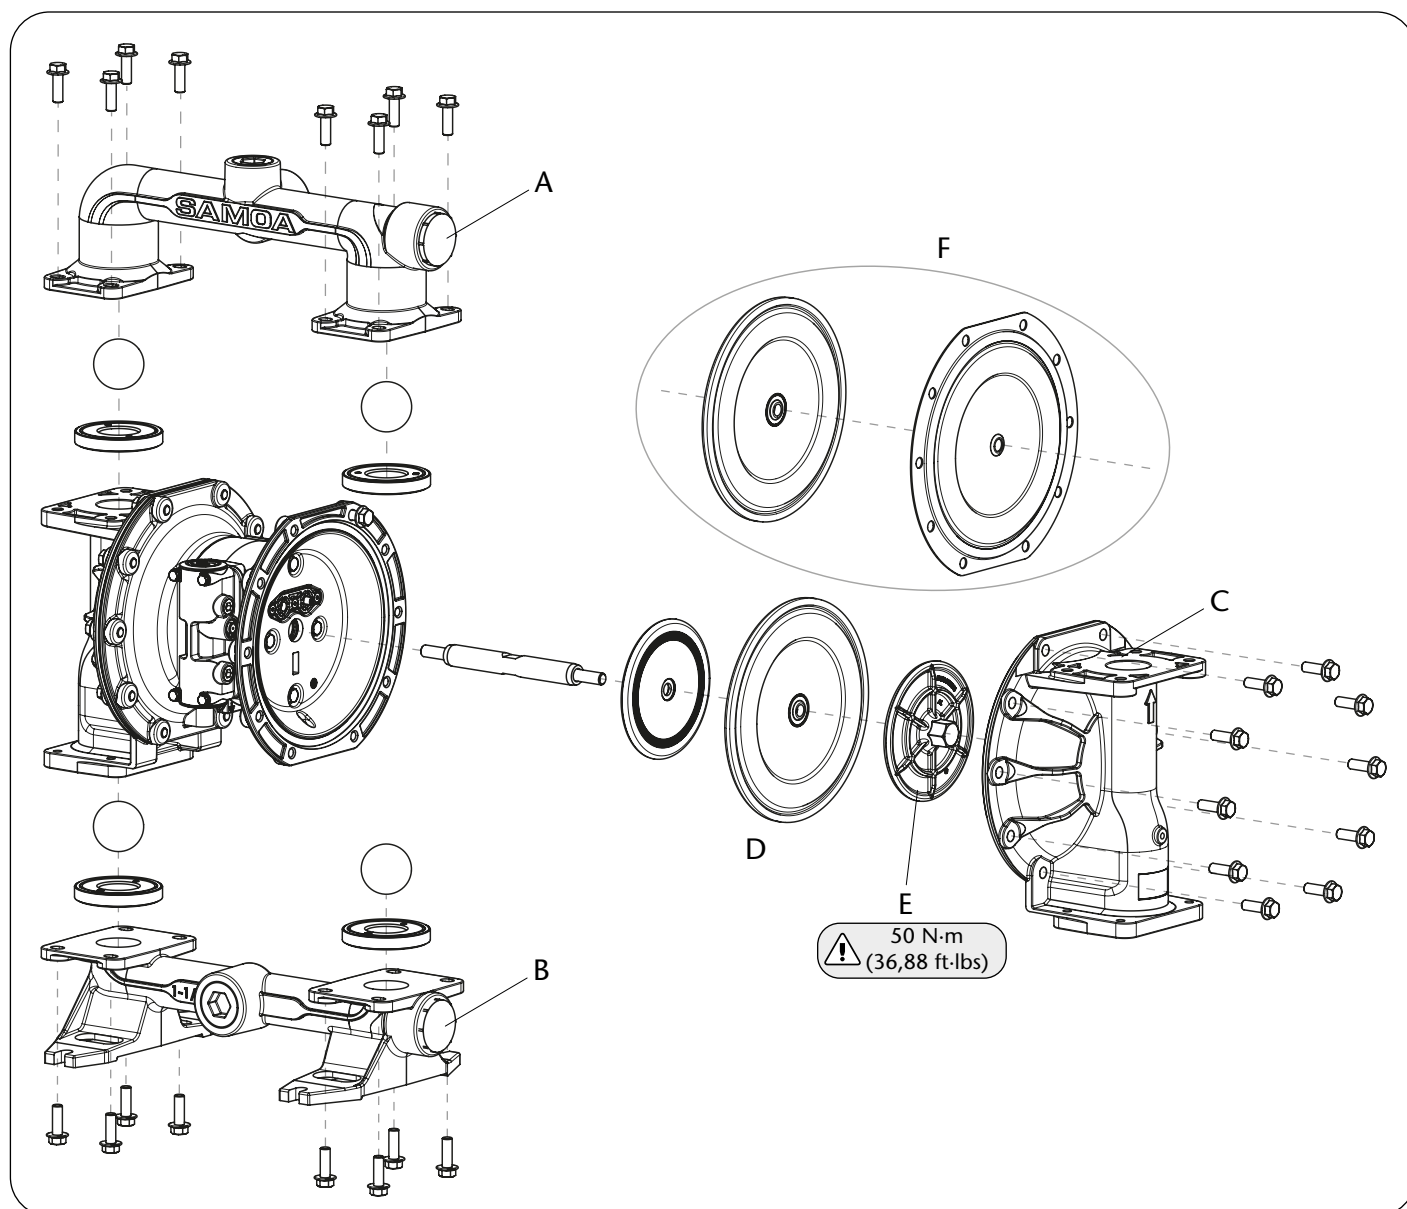

2025_09_15-17:25

**EC DECLARATION OF CONFORMITY****The manufacturer****SAMOA INDUSTRIAL, S.A.**, Pol. Ind. Porceyo, I-14 ·

Camino del Fontán, 831 · 33392 - Gijón - Spain

Tel: +34 985 381 488

e-mail: info@samoaindustrial.com

Declares under its own responsibility, that the product:

UP15X-XXX-XXX
UP15 1 1/2" Double Diaphragm Metallic Pumpcomplies with the directives: **2006/42/CE**

This declaration refers exclusively to the product in the state in which it was placed on the market, excluding added components and modifications made by the end user.

**Pedro E. Prallong Álvarez**
Production Manager

2025_09_15-17:25



www.samoaindustrial.com

